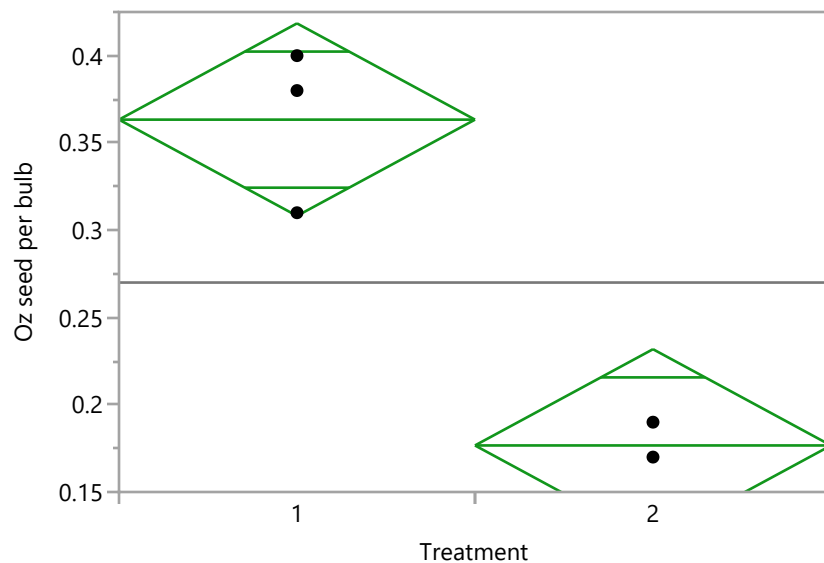


Oneway Analysis of Oz seed per bulb By Treatment**Oneway Anova****Summary of Fit**


Rsquare	0.916959
Adj Rsquare	0.896199
Root Mean Square Error	0.0344
Mean of Response	0.27
Observations (or Sum Wgts)	6

Pooled t Test

2-1

Assuming equal variances

Difference	-0.18667	t Ratio	-6.64598
Std Err Dif	0.02809	DF	4
Upper CL Dif	-0.10868	Prob > t	0.0027*
Lower CL Dif	-0.26465	Prob > t	0.9987
Confidence	0.95	Prob < t	0.0013*

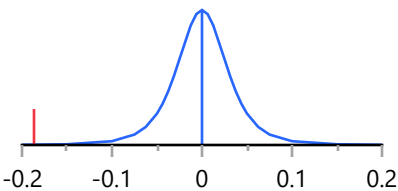**Analysis of Variance**

Source	DF	Sum of Squares	Mean Square	F Ratio	Prob > F
Treatment	1	0.05226667	0.052267	44.1690	0.0027*
Error	4	0.00473333	0.001183		
C. Total	5	0.05700000			

Means for Oneway Anova

Level	Number	Mean	Std Error	Lower 95%	Upper 95%
1	3	0.363333	0.01986	0.30819	0.41848
2	3	0.176667	0.01986	0.12152	0.23181

Std Error uses a pooled estimate of error variance