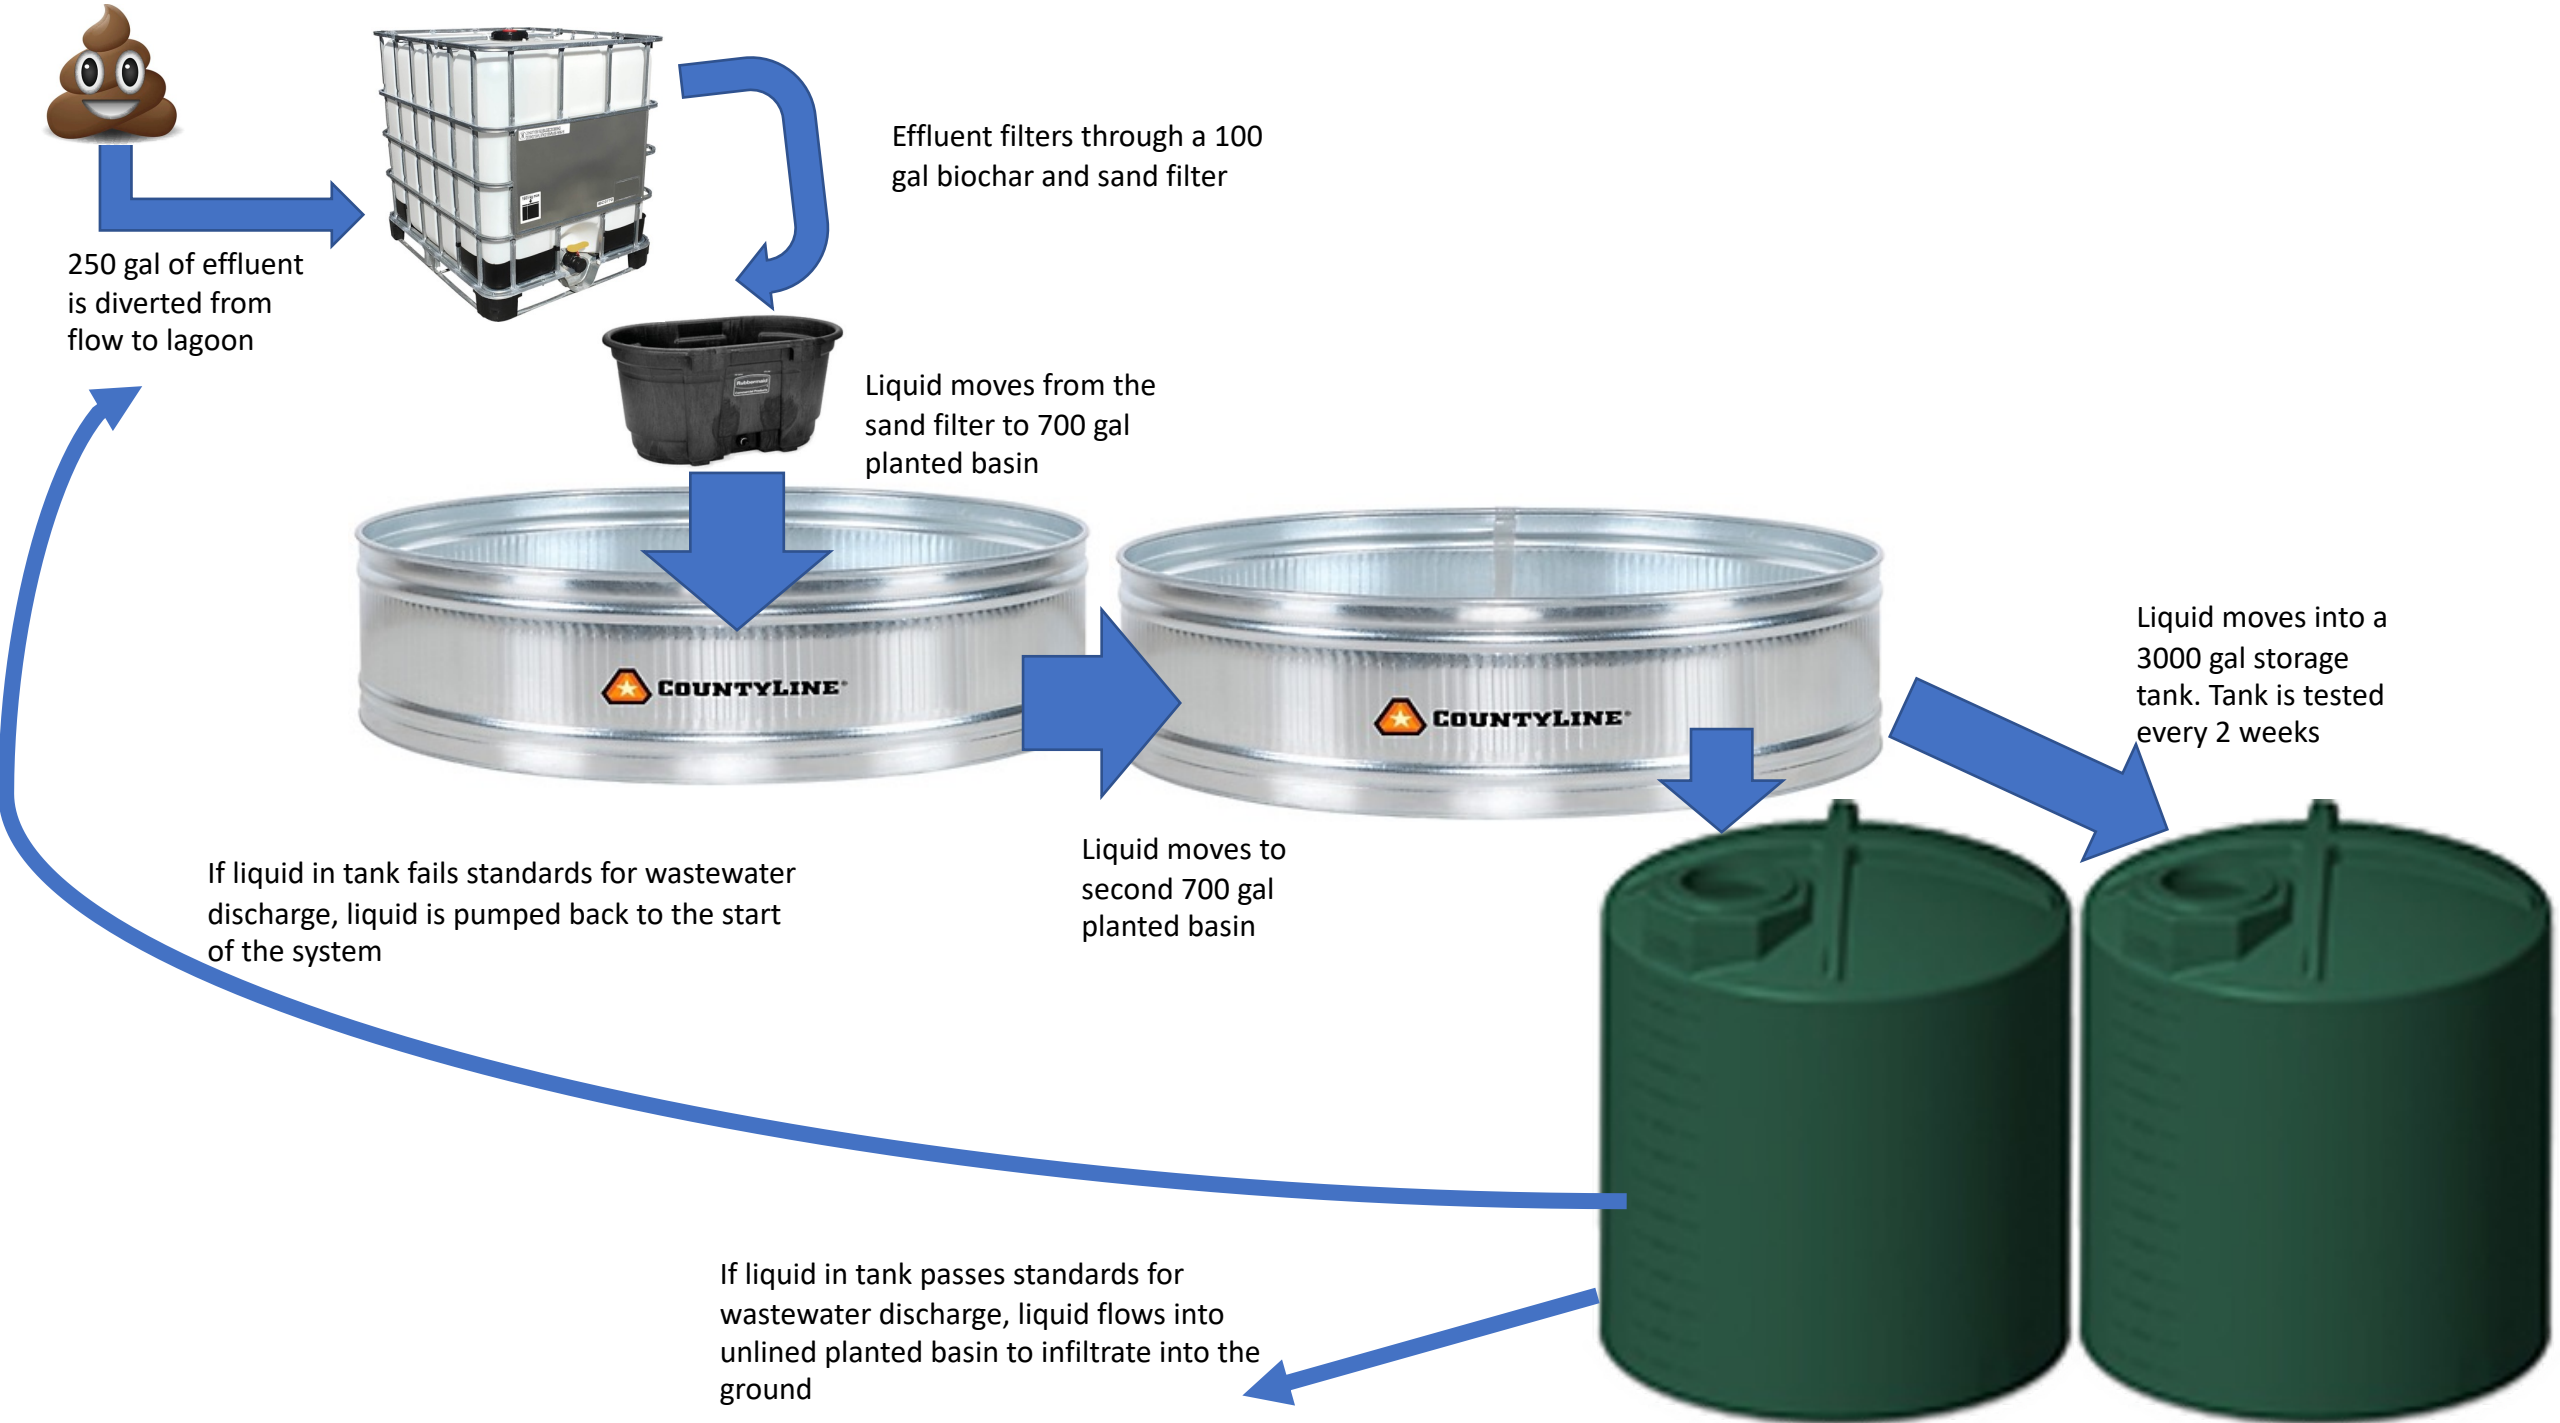
250 gal of effluent is diverted from flow to lagoon
Effluent filters through a 100 gal biochar and sand filter
Liquid moves from the sand filter to 700 gal planted basin
COUNTYLINE
COUNTYLINE
Liquid moves into a 3000 gal storage tank. Tank is tested every 2 weeks
Liquid moves to second 700 gal planted basin
If liquid in tank fails standards for wastewater discharge, liquid is pumped back to the start of the system
If liquid in tank passes standards for wastewater discharge, liquid flows into unlined planted basin to infiltrate into the ground